

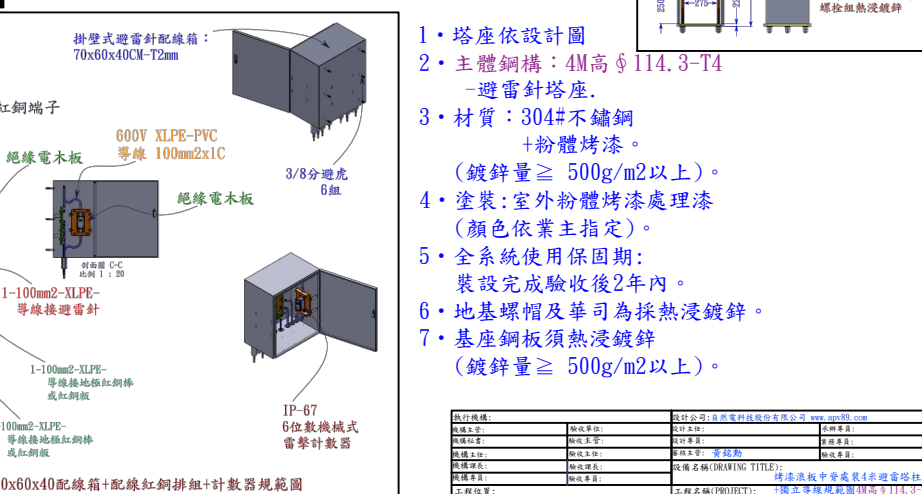
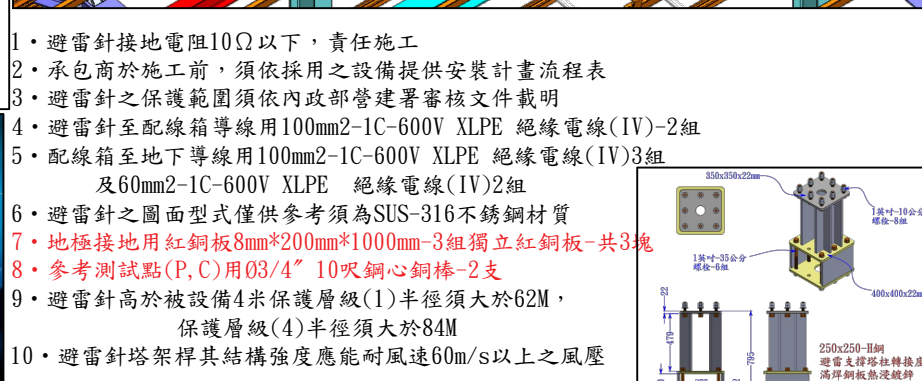
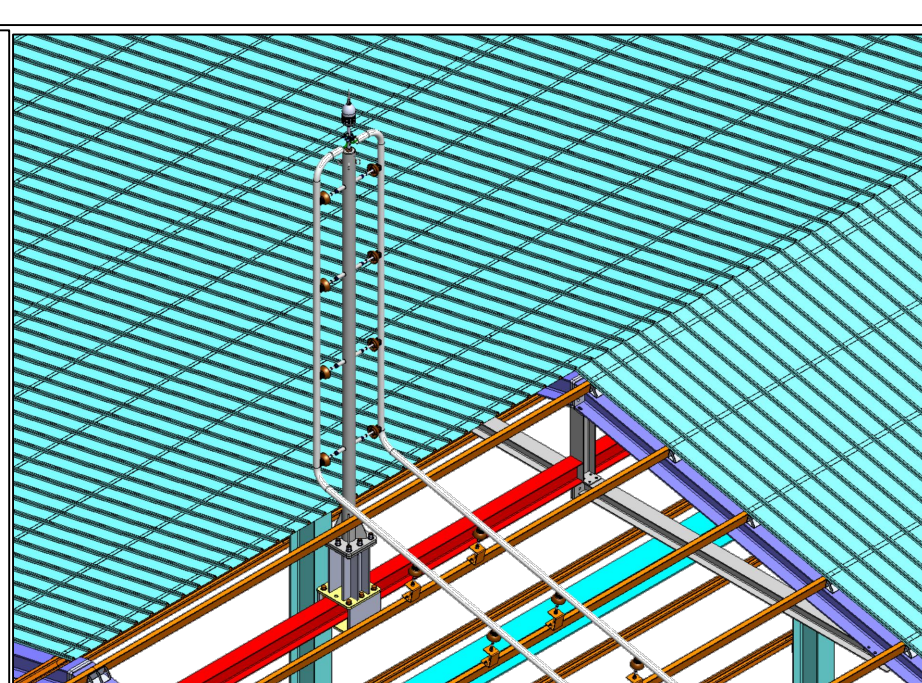
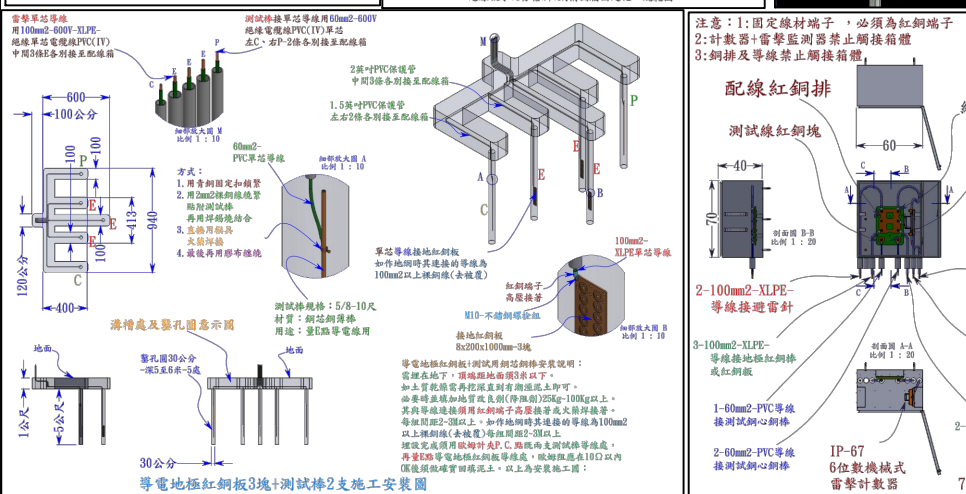
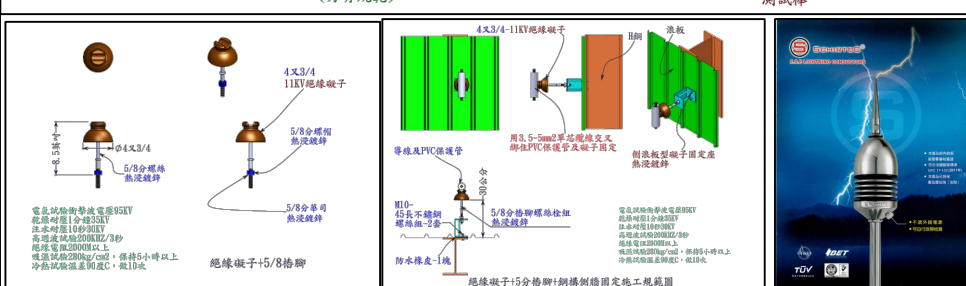
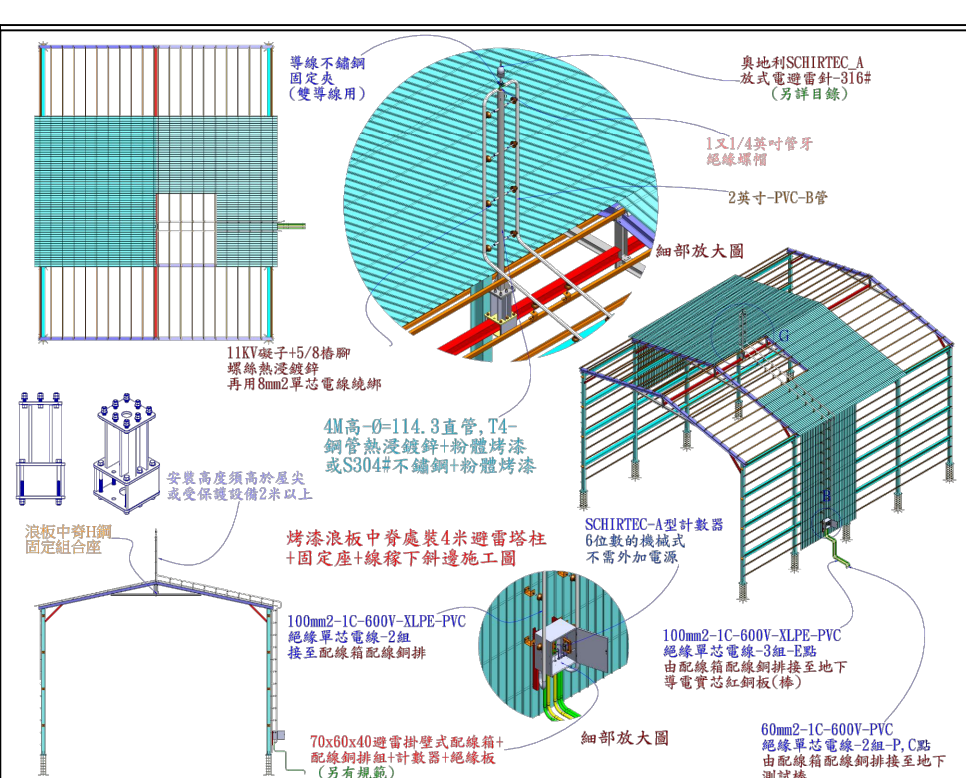


Table with 2 columns: Item No. and Description. It lists various components and their specifications.

Table with 2 columns: Item No. and Description. It lists various components and their specifications.

1. 避雷針接地電阻10Ω以下，責任施工
2. 承包商於施工前，須依採用之設備提供安裝計畫流程表
3. 避雷針之保護範圍須依內政部營建署審核文件載明
4. 避雷針至配線箱導線用100mm2-1C-600V XLPE 絕緣電線(IV)-2組
5. 配線箱至地下導線用100mm2-1C-600V XLPE 絕緣電線(IV)3組
6. 及60mm2-1C-600V XLPE 絕緣電線(IV)2組
7. 避雷針之圖面型式僅供參考須為SUS-316不銹鋼材質
8. 地極接地用紅銅板8mm*200mm*1000mm-3組獨立紅銅板-共3塊
9. 參考測試點(P, C)用Ø3/4" 10呎鋼心銅棒-2支
10. 避雷針高於被設備(4)半徑須大於84M
11. 保護層級(4)半徑須大於84M
12. 避雷針塔架桿其結構強度應能耐風速60m/s以上之風壓

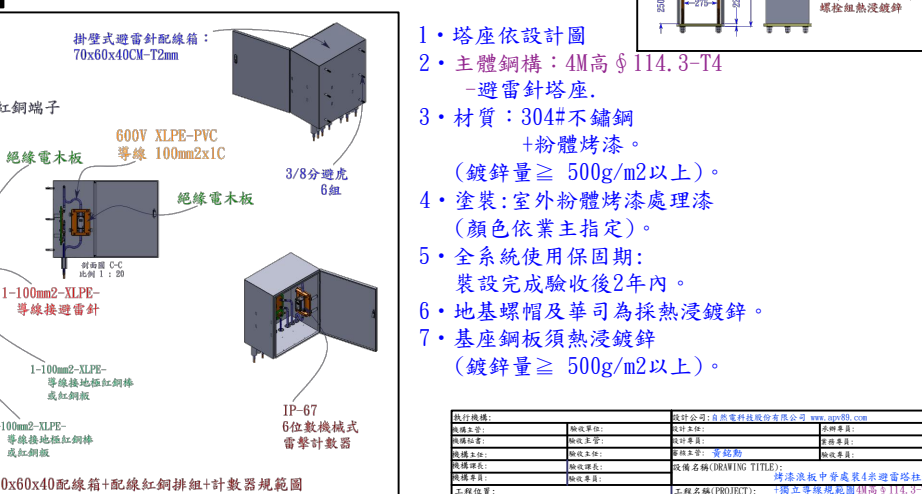


Table with 2 columns: Item No. and Description. It lists various components and their specifications.